

Petition No. /TT/2018

Determination of tariff for the TSTRANSCO owned Inter State Transmission Lines/System of the 38 Nos. natural Inter-State Transmission lines connecting Telangana and Andhra Pradesh States as per the Central Electricity Regulatory Commission order dated 14.03.2012 in petition No15/Suo-Motu/2012, for inclusion in PoC Transmission charges in accordance with Central Electricity Regulatory Commission (Terms and Conditions of Tariff) Regulations, 2014

Transmission Corporation of Telangana Limited ... Petitioner

Transmission Corporation of Andhra Pradesh
Limited & Ors. ... Respondents

S.No.	Particulars	Page No.
1	Form 1	1-2
1	Memo of Parties	3
2	Petition with Affidavit	4-15
3	Annexure P-1 Certificate issued by RPC Dt. 23.11.2016	16-17
4	Annexure P-2 Certification of Interstate Transmission lines owned by STU	18-19
5	Vakalatnama	20

Place : New Delhi
Date: 10.08.2018

Sri Harsha Peechara
Ashish Tiwari & Vidhi Jain
Counsel for Petitioner
C-1A (LGF), Nizamuddin East
New Delhi-110013
9717466788

Form - I (Payment Related Report)

Particulars		
1.	Name of the Petitioner / Applicant	TRANSMISSION CORPORATION OF TELANGANA LTD TSTRANSCO
2.	Address of the Petitioner / Applicant	6-3-572 Vidyut Sauda, Khairatabad Hyderabad*
3.	Subject Matter	(Determination of tariff for the TSTRANSCO owned Inter State Transmission Lines/System of the 38 Nos. natural Inter-State Transmission lines connecting Telangana and Andhra Pradesh States as per the Central Electricity Regulatory Commission order dated 14.03.2012 in petition No15/Suo-Motu/2012, for inclusion in PoC Transmission charges in accordance with Central Electricity Regulatory Commission (Terms and Conditions of Tariff) Regulations, 2014)
4.	Diary No.	331/2018
5.	Petition No., if any	
6.	Details of generation / Transmission assets	TT
	(a) Generating station / units	132 KV A.P.CARBIDES - ALAMPUR,132 KV A.P. CARBIDES - GADWAL ,132 KV CHILLAKALLU - BONAKALLU FEEDER - I & FEEDER - II,132 KV CHILLAKALLU - KHAMMAM LINE,132 KV CHILLAKALLU - KUSUMANCHI LINE,132 KV CHILLAKALLU - MADHIRA LINE,132 KV CHILLAKALLU - RAMAPURAM LINE,132 KV CHILLAKALLU - SITAPURAM LINE,132 KV CHILLAKALLU - KODADA LINE,132 KV K.KOTA - ASWARAOPET FEEDER- I & II,132 KV NAGARJUNA SAGAR - RCPH FEEDER,132 KV PIDUGURALLA - WADAPALLI,132 KV SITAPURAM - KCP LINE,132 KV TANGEDA - WADAPALLI LINE,220 KV BRAHMANAKOTKUR - WANAPARTHY LINE (LIS),220 KV CHILLAKALLU - NARKETPALLI FEEDER - I & FEEDER - II,220 KV LSR - KTPS FEEDER - I,220 KV LSR - KTPS - FEEDER-II,220KV N'SAGAR RECEIVING STN. - SRISAILAM SC LINE,220 KV NUNNA - KTPS LINE,220 KV SRISAILAM - DINDI FEEDERS - I & II,220 KV TALLAPALLI - CHALAKURTHY FEEDER,220 KV TALLAPALLI - NAGARAJUNASAGAR DC LINE,220 KV TALLAPALLI - NAGARAJUNASAGAR - III FEEDER,400 KV KALAPAKA - KHAMMAM & 400 KV KALAPAKA - ASUPAKA LINES,400KV SRISAILAM - KURNOOL SC FEEDER,400 KV SRISAILAM - SATTENAPALLI DC LINE,400 KV VTPS- MALKARAM & VTPS- SURYAPET DC LINES
	(b) Capacity in MW / ATC	1705000,15161000,2037000,10185000,13677000,27650
	(c) Date of commercial operation	20/01/1987,13/01/2000,20/01/1987,02/12/2001,24/12/19
	(d) Period of which fee paid	2014-2019
	(e) Amount Paid	1140800
	(f) Surcharge, if any	0
7.	Application fee for licence	

Aug 10, 2018, 9:54 AM



	(a) Trading licence	
	(b) Transmission licence	
	(c) Period of which paid	
	(d) Amount of fee paid	
8.	Fee paid for Miscellaneous Application	
9.	Fee paid for Interlocutory Application	
10	Fee paid for Regulatory Compliance petition	
	Fee paid for Review Application	
	Licence fee for inter-state trading	
	(a) Category	
	(b) Period	
	(c) Amount of fee paid	
	(d) Surcharge, if any	
	Annual Registration Charge for Power Exchange	
	(a) Period	
	(b) Amount of turnover	
	(c) Fee paid	
	(d) Surcharge, if any	
	Details of fee remitted	
	(a) UTR No.	SBI52018061200013457
	(b) Date of remittance	'2018-07-20 17:27:32.993'
	(c) Amount remitted	'1140800'
Note : While Sl. Nos. 1 to 3 and 16 are compulsory, the rest may be filled up as applicable.		
Signature of the authorized signatory with date		<i>[Signature]</i> 10/8/2018

Place : New Delhi
Date: 10.08.2018

[Signature]
Sri Harsha Peechara
Ashish Tiwari & Vidhi Jain
Counsel for Petitioner
C-1A (LGF), Nizamuddin East
New Delhi-110013
9717466788

BEFORE THE CENTRAL ELECTRICITY REGULATORY COMMISSION
NEW DELHI

MEMO OF PARTIES

In the matter of :

Transmission Corporation Of Telangana Limited, 6-3-572,
Vidyut Soudha, Khairtabad, Hyderabad, Telangana –
500082.


.... Petitioner

Versus

1. Transmission Corporation of Andhra Pradesh Limited,
Vidyut Soudha, Gunadala, Eluru Road, Vijayawada,
Andhra Pradesh – 520004.
2. Chief Engineer, Commercial, TSPCC, Room No.455,
A-Block, 4th Floor, Vidyut Soudha, Khairathabad,
Hyderabad, Telangana – 500082.
3. Chief Engineer, Commercial, APPCC, Room No.451,
A-Block, 4th Floor, Vidyut Soudha, Khairathabad,
Hyderabad, Telangana – 500082.

..... Respondents




Chief Engineer/Comm. & RAC
TSTRANSCO, Vidyut Soudha,
HYDERABAD - 500 082.

4

BEFORE THE CENTRAL ELECTRICITY REGULATORY COMMISSION
NEW DELHI

Petition No. /TT/2018

IN THE MATTER OF :

Determination of tariff for the TSTRANSCO owned Inter State Transmission Lines/System of the 38 Nos. natural Inter-State Transmission lines connecting Telangana and Andhra Pradesh States as per the Central Electricity Regulatory Commission order dated 14.03.2012 in petition No. 15/Suo-Motu/2012, for inclusion in PoC Transmission charges in accordance with Central Electricity Regulatory Commission (Terms and Conditions of Tariff) Regulations, 2014.


IN THE MATTER OF :

Transmission Corporation of Telangana Limited

... Petitioner

Versus

Transmission Corporation of Andhra Pradesh Limited & Ors.

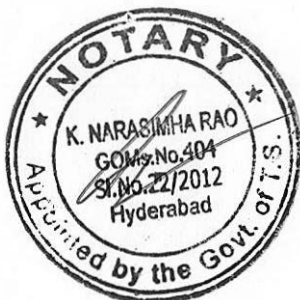


Chief Engineer/Comml. & RAC
TSTRANSCO, Vidyut Soudha,
HYDERABAD - 500 082.

4A

The Applicant respectfully submits as under: -

1. APTRANSCO has filed petition No.237/TT/2016 before the Hon'ble CERC through e-filing for determination of tariff of the Inter-State transmission lines connecting two States for the APTRANSCO owned transmission lines/system on 02.11.2016.
2. Later 400kV Uravakonda – Veltur CKT I & II interstate lines between AP & Telangana was taken into service on 18.11.2016. These lines were certified by the SRPC vide letter No.SRPC/SE-1/4(Dev)/2016 dt.23.11.2016. These lines were also included in the Revised Petition filed by APTRANSCO. The certificate issue by RPC is annexed as **Annexure**.
3. The Technical Committee formed by the Hon'ble Commission has taken into consideration of various objections raised by the TSTRANSCOs on sharing of ISTS charges of these natural interstate lines.
4. In this connection, TSTRANSCO also has decided to file the petition before CERC for determination of Tariff of the 38 Nos. natural Inter-State Transmission Lines connecting Telangana & Andhra Pradesh States for the TSTRANSCO owned Transmission Lines/System.





Chief Engineer/Comml. & RAC
TSTRANSCO, Vidyut Soudha,
HYDERABAD - 500 082.

5

5. In view of the respondent's claim that APTRANSCO is the owner of the lines in the Petition, the Petitioner humbly submits that the natural ISTS lines formed due to bifurcation of the erstwhile AP State will become owned by the successor Transcos of each State.


6. The following 38 lines (Telangana – AndhraPradesh) are included in this petition by TSTRANSCO to claim Yearly Transmission Charges for its natural ISTS lines between Telangana and AndhraPradesh.

Sl. No.	Name of Line	Connecting States
1	400 KV VTPS - Malkaram Line	 Telangana & Andhra Pradesh
2	400 KV VTPS - Suryapet Line	
3	400 KV Srisaillam - Sattenapalli Ckt I	
4	400 KV Srisaillam - Sattenapalli Ckt II	
5	400 KV Srisaillam - Kurnool (SC) feeder	
6	400 KV Kalpaka - Khammam - I feeder	
7	400 KV Kalpaka – Asupaka (Khammam -II) feeder	
8	400 KV Uravakonda - Veltoor- I feeder	
9	400 KV Uravakonda - Veltoor- II feeder	
10	220 KV Nunna - KTPS Line	
11	220 KV Tallapalli - Nagarjunasagar - I feeder	
12	220 KV Tallapalli - Nagarjunasagar - II feeder	



476

Sl. No.	Name of Line	Connecting States
13	220 KV Tallapalli - Nagarjunasagar - III feeder	 Telangana & Andhra Pradesh 
14	220 KV Tallapalli - Chalakurthy feeder	
15	220 KV Chillakallu - Narketpalli - I feeder	
16	220 KV Chillakallu - Narketpalli - II feeder	
17	220 KV Brahmnaotkur - Wanaparthi line (LIS)	
18	220 KV Srisaalam - Dindi - I feeder	
19	220 KV Srisaalam - Dindi - II feeder	
20	220 KV N'Sagar Receiving Station - Srisaalam SC Line	
21	220 KV LSR - KTPS - I feeder	
22	220 KV LSR - KTPS - II feeder	
23	132 KV Nagarjunasagar - RCPH feeder	
24	132 KV Piduguralla - Wadapalli	
25	132 KV Tangeda - Wadapalli line	
26	132 KV Chillakallu - Kodada line	
27	132 KV Chillakallu - Ramapuram line	
28	132 KV Chillakallu - Sitapuram line	
29	132 KV Chillakallu - Khammam line	
30	132 KV Chillakallu - Kusumanchi line	
31	132 KV Chillakallu - Madhira line	

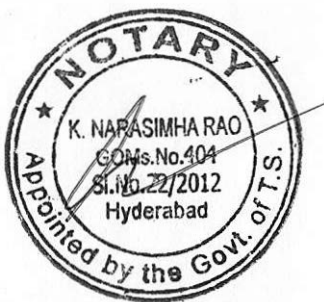



 Chief Engineer/Comml. & RAC
 TSTRANSCO, Vidyut Soudha,
 HYDERABAD - 500 082.

Sl. No.	Name of Line	Connecting States
32	132 KV Sitapuram - KCP line	 Telangana & Andhra Pradesh
33	132 KV Chillakallu - Bonakallu - I feeder	
34	132 KV Chillakallu - Bonakallu - II feeder	
35	132 KV A.P.Carbides - Alampur	
36	132 KV A.P.Carbides - Gadwal	
37	132 KV K.Kota - Aswaraopet - I feeder	
38	132 KV K.Kota - Aswaraopet - II feeder	


7. In this petition, the Petitioner has adopted the same YTC/Ckt-KM for each type of conductor configuration, as claimed by APTRANSCO in their Petition, for determination of YTC for ISTS Lines/System owned by TSTRANSCO taking into consideration of the following reasons.

(i) The ARR & Tariff Order (issued for the combined State of AP by the erstwhile APERC, Dated 09-05-2014) was adopted by both the utilities (i.e., APTRANSCO and TSTRANSCO) up to FY 2016-17 and (ii) the conductor-wise and voltage-wise configuration of TSTRANSCO transmission system are same as that of APTRANSCO transmission system which was mentioned in their Petition.

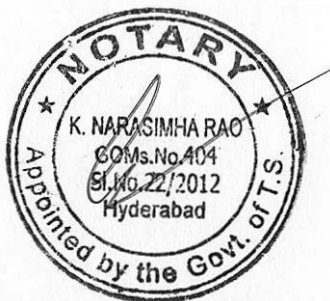


8. The YTC for the TSTransco owned Inter State Transmission Lines/System of the 38 Nos. natural Inter-state transmission lines connecting TS & AP are computed based on the rates arrived by APTRANSCO, tabulated below.

Sl. No.	Name of Line	Configuration & Type of Conductor	Ckt-KM	YTC /Ckt-KM (Rs.Lakhs/ Ckt-KM)	YTC (Rs.Lakhs/ Annum)	D.O.C
1	400 KV VTPS - Malkaram line	D/C ACSR TWIN MOOSE	378.64	10.44	3953.00	02.04.2013
2	400 KV VTPS - Suryapet line					
3	400 KV Srisaillam - Sattenapalli Ckt I	D/C ACSR TWIN MOOSE	1.20	10.44	12.53	12.02.2014
4	400 KV Srisaillam - Sattenapalli Ckt II					
5	400 KV Srisaillam - Kurnool (SC) feeder	S/C ACSR TWIN MOOSE	1.50	14.48	21.75	06.03.2001
6	400 KV Kalpaka - Khammam - I feeder	D/C ACSR TWIN MOOSE	242.00	10.44	2526.48	10.05.2002
7	400 KV Kalpaka - Asupaka (Khammam - II) feeder					
8	400 KV Uravakonda - Veltoor - I feeder	D/C ACSR Quad Moose	147.20	18.05	2656.96	17.11.2016
9	400 KV Uravakonda - Veltoor - II feeder					18.11.2016
10	220 KV Nunna - KTPS Line	S/C ACSR DEER	64.45	4.89	315.16	21.01.1992

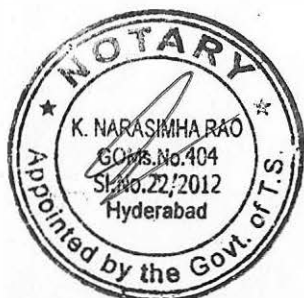


159

Sl. No.	Name of Line	Configuration & Type of Conductor	Ckt-KM	YTC /Ckt-KM (Rs.Lakhs/ Ckt-KM)	YTC (Rs.Lakhs/ Annum)	D.O.C
11	220 KV Tallapalli - Nagarjunasagar - I feeder	D/C ACSR TWIN MOOSE	4.20	4.14	17.39	05.08.1985
12	220 KV Tallapalli - Nagarjunasagar - II feeder					
13	220 KV Tallapalli - Nagarjunasagar - III feeder	S/C ACSR ZEBRA	4.00	4.89	19.56	27.01.1985
14	220 KV Tallapalli - Chalakurthy feeder	S/C ACSR ZEBRA	27.40	4.89	133.99	21.07.2007
15	220 KV Chillakallu - Narketpalli - I feeder	D/C ACSR MOOSE	216.00	4.14	894.24	10.03.2010
16	220 KV Chillakallu - Narketpalli - II feeder					
17	220 KV Brahmna Kotkur - Wanaparthy line (LIS)	S/C ACSR MOOSE	78.79	4.89	385.28	29.10.2009
18	220 KV Srisaillam - Dindi - I feeder	D/C ACSR ZEBRA	160.00	4.14	662.40	12.09.1982
19	220 KV Srisaillam - Dindi - II feeder					
20	220 KV N'Sagar Receiving Station - Srisaillam SC Line	S/C ACSR DEER	4.00	4.89	19.56	07.02.1989
21	220 KV LSR - KTPS - I feeder	S/C ACSR DEER	81.00	4.89	396.09	31.03.1967
22	220 KV LSR - KTPS - II feeder	S/C ACSR DEER	81.00	4.89	396.09	31.03.1979

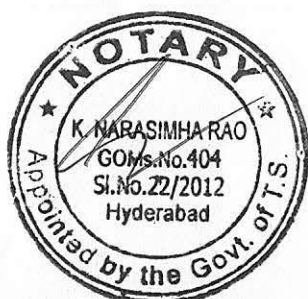

[Signature]
 Chief Engineer/Comm. & RAC
 TSTRANSCO, Vidyut Sadha,
 HYDERABAD - 500 082.


Sl. No.	Name of Line	Configuration & Type of Conductor	Ckt-KM	YTC / Ckt-KM (Rs.Lakhs/ Ckt-KM)	YTC (Rs.Lakhs/ Annum)	D.O.C
23	132 KV Nagarjunasagar - RCPH feeder	S/C ACSR BEAR	7.70	3.95	30.42	25.02.1983
24	132 KV Piduguralla - Wadapalli	S/C ACSR PANTHER	2.36	3.95	9.32	22.02.2014
25	132 KV Tangeda - Wadapalli line	S/C ACSR PANTHER	2.36	3.95	9.32	26.08.2010
26	132 KV Chillakallu - Kodada line	S/C ACSR PANTHER	9.84	3.95	38.87	10.06.2004
27	132 KV Chillakallu - Ramapuram line	D/C ACSR PANTHER	17.00	2.91	49.47	21.10.1982
28	132 KV Chillakallu - Sitapuram line	D/C ACSR PANTHER	2.00	2.91	5.82	06.04.2004
29	132 KV Chillakallu - Khammam line	D/C ACSR PANTHER	35.00	2.91	101.85	02.12.2001
30	132 KV Chillakallu - Kusumanchi line	D/C ACSR PANTHER	47.00	2.91	136.77	24.12.1985
31	132 KV Chillakallu - Madhira line	S/C ACSR PANTHER	7.00	3.95	27.65	27.10.2001
32	132 KV Sitapuram - KCP line	S/C ACSR PANTHER	0.37	3.95	1.46	10.05.2010
33	132 KV Chillakallu - Bonakallu - I feeder	D/C ACSR PANTHER	7.00	2.91	20.37	20.01.1987
34	132 KV Chillakallu - Bonakallu - II feeder					
35	132 KV A.P.Carbides - Alampur	D/C ACSR PANTHER	5.86	2.91	17.05	20.01.1987
36	132 KV A.P.Carbides - Gadwal	D/C ACSR PANTHER	52.10	2.91	151.61	13.01.2000

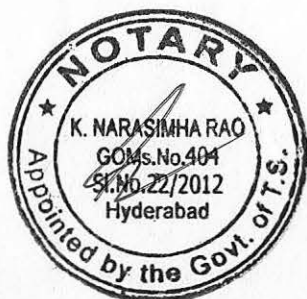


Ans
 Chief Engineer/Comm. & RAC
 TSTRANSCO, Vidyut Soudha,
 HYDERABAD - 500 082.

11

Sl. No.	Name of Line	Configuration & Type of Conductor	Ckt-KM	YTC / Ckt-KM (Rs.Lakhs/ Ckt-KM)	YTC (Rs.Lakhs/ Annum)	D.O.C
37	132 KV K.Kota - Aswaraopet - I feeder	D/C ACSR PANTHER	5.90	2.91	17.11	09.06.1982
38	132 KV K.Kota - Aswaraopet - II feeder					
	Total		1,692.87		13,027.60	

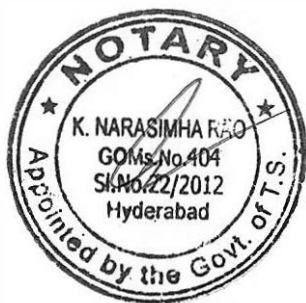


 Chief Engineer/Comm. & RAC
 TSTRANSCO, Vidyut Soudha,
 HYDERABAD - 500 082.

PRAYER

12
10/8/18
11

In the above circumstances, the petitioner respectfully prays this Hon'ble Commission

- (a) to approve the annual fixed charges for the assets covered under this Petition;
- (b) to determine the tariff of the Inter-State transmission lines connecting two states;
- (c) to include the assets in POC Transmission charges, in accordance with Central Electricity Regulatory Commission (Terms and Conditions of Tariff) Regulations, 2014; and
- (d) to pass any other order or relief as this Hon'ble Commission may deem fit and proper in the facts and circumstances of the case.

Place - Delhi
Date :- 10/8/18

hs

Petitioner

Chief Engineer/Comml. & RAC
TSTRANSCO, Vidyut Soudha,
HYDERABAD - 500 082.


5/20/25/2004
(Sri Sriharsha Peechara)

Counsel for TSTRANSCO



BEFORE THE CENTRAL ELECTRICITY REGULATORY COMMISSION
NEW DELHI

Petition No. /TT/2018

In the matter of :

Determination of tariff for the TSTRANSCO owned Inter State Transmission Lines/System of the 38 Nos. natural Inter-State Transmission lines connecting Telangana and Andhra Pradesh States as per the Central Electricity Regulatory Commission order dated 14.03.2012 in petition No. 15/Suo-Motu/2012, for inclusion in PoC Transmission charges in accordance with Central Electricity Regulatory Commission (Terms and Conditions of Tariff) Regulations, 2014.

In the matter of :

Transmission Corporation of Telangana Limited.

... Petitioner

Versus

Transmission Corporation of Andhra Pradesh Limited

... Respondent



14

AFFIDAVIT

I, M. Srinivas, S/o M. Thirupathi, Aged 53 years, officiating as Chief Engineer/Comml.&RAC, TSTRANSCO at Room No.149, TSTRANSCO, A-Block, Vidyut Soudha, Somajiguda, Hyderabad, Telangana – 500 082 do solemnly affirm and say as follows:

1. I am the Chief Engineer/Comml.&RAC, TSTRANSCO, the licensee company operating and controlling the Transmission Business & SLDC Activity of electricity in Telangana pursuant to the license granted by the erstwhile APERC. I am competent and duly authorized by TSTRANSCO to affirm, swear, execute and file this affidavit in the present proceedings.
2. I have read and understood the contents of the accompanying Petition for Determination of Tariff for newly identified Inter-State Lines of TSTRANSCO. The statements made in the paragraphs of the accompanying application now shown to me are true to the best of my knowledge derived from the official records made available to me and are based on information and advice received which I believe to be true and correct.



DEPONENT


Chief Engineer/Comml. & RAC
TSTRANSCO, Vidyut Soudha,
HYDERABAD - 500 082.

15
12


VERIFICATION :

I, the above named Deponent solemnly affirm on this 2nd day of August, 2018 that the contents of the above affidavit are true to my knowledge, no part of it is false and nothing material has been concealed there from.

DEPONENT



Chief Engineer/Comml. & RAC
TSPTRANSCE, Vidyut Soudha,
HYDERABAD - 500 082.

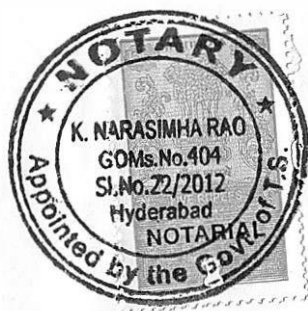

ATTESTED



K. NARASIMHA RAO, B.A., LL.B
ADVOCATE / NOTARY
Appointed by the Govt. of T.S.
10-1-891/401, A.C. Guards
Khairatabad. HYDERABAD.

Annexure - P1

16



भारत सरकार
केन्द्रीय विद्युत प्राधिकरण
दक्षिण क्षेत्रीय विद्युत समिति
29, रेस कोर्स क्रॉस रोड
बंगलूरु - 560 009



Government of India
Central Electricity Authority
Southern Regional Power Committee
29, Race Course Cross Road
BENGALURU - 560 009



अ/सं. 1/201-750
ISO: 9001-2000

Phone : 080 -2228 2516 ; FAX : 080-2225 9343; e-mail: secommmisrpsc-ka@nic.in ; web site: www.srpc.kar.nic.in

सं. दक्षेविस /अर्थ.1/4(विचलन)/2016/

No. SRPC/SE-1/4(Dev)/2016/ 7296 - 97

दिनांक /Dated: 31 October, 2016

सेवा में / To

The Secretary,
CERC,
New Delhi

Subject: -Certification of Interstate Transmission lines owned by STU, which carry inter-State power, for consideration of inclusion in POC charges, 2016-Reg.

Sir,

Chief Engineer, SLDC, APTRANSCO, Andhra Pradesh, vide letter No. CE/SLDC/SE/SLDC/E.No.POC/D.No.634 /16, dated 26.10.2016, requested for the SRPC certification of the interstate lines owned of AP STU, so that the same lines can be considered for inclusion in POC charges.

Regarding inclusion of interstate, non-ISTS line in the POC transmission charges the following is contained at Para 2.6 in the CERC order dated 28.1.2016 on Petition No. 225/TT/2013:

"As a first step towards inclusion of non-ISTS lines in the POC transmission charges, the Commission proposes to include the transmission lines connecting two States, for computation of POC transmission charges and losses."

Accordingly, the lines enclosed at Annexure-I owned by Andhra Pradesh STU connecting Andhra Pradesh with other states, viz, Telangana, Tamil Nadu, Karnataka and Union Territory of Puducherry are certified as interstate lines owned by APTRANSCO connecting another state.


Yours faithfully,

3 NOV 2016

आर.एम. रंगराजन
(आर.एम. रंगराजन/R. M Rangarajan)

संलग्नक: यथोपरि Encl: as above

परिचालन अभियन्ता(वा)/Superintending Engineer (C)

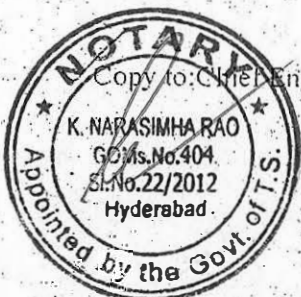


True Copy

Chief Engineer/Comm. & RAC
APTRANSCO, Vidyal Soudha,
HYDERABAD - 500 082.

17

ANNEXURE I

Inter-State lines owned by AP STU			
S.NO	Substation	Name of the Line	Connectde.to
1	Sattennapalli	400kV Srisailam LB Line-2	Telangana
2	Sattennapalli	400kV Srisailam LB Line-1	Telangana
3	Kurnool	400kV Srisailam LB	Telangana
4	VTPS	400kV Suryapet	Telangana
5	VTPS	400kV Malkaram Line-1	Telangana
6	Talapalli	220kV Chalakurthy Line	Telangana
7	Brahmanakotkar	220kV Wanaparthy Line	Telangana
8	Talapalli	220kV N'Sagar Line-3	Telangana
9	Talapalli	220kV N'Sagar Line-2	Telangana
10	Talapalli	220kV N'Sagar Line-1	Telangana
11	Srisailam RB	220kV N'Sagar Line Receiving stn	Telangana
12	Chillakallu	220kV Narketpalli Line-2	Telangana
13	Chillakallu	220kV Narketpalli Line-1	Telangana
14	L. Sileru	220kV KTPS line II	Telangana
15	L. Sileru	220kV KTPS line I	Telangana
16	Nunna	220kV KTPS Line	Telangana
17	Sulurpet	220kV Gummidipondi line	Tamil Nadu
18	Srisailam RB	220kV Dindi line II	Telangana
19	Srisailam RB	220kV Dindi line I	Telangana
20	Chittoor(220 kV)	220 kV Tiruvalam line	Tamil Nadu
21	Ragulapadu	220 kV Bellary line	Karnataka
22	Piduguralla#	132kV Wadapalli Line	Telangana
23	Tangeda	132kV Wadapalli Line	Telangana
24	Chillakallu	132kV Seethapuram Line	Telangana
25	KCP Cements	132kV Seethapuram Line	Telangana
26	Chillakallu	132kV Rampuram Line	Telangana
27	N'Sagar RC	132kV N'Sagar Line	Telangana
28	Chillakallu	132kV Madhira Line	Telangana
29	Chillakallu	132kV Kodada Line	Telangana
30	Chillakallu	132kV Khammam Line	Telangana
31	Chillakallu	132kV Kasumanchi Line	Telangana
32	Chillakallu	132kV Bonakal Line-2	Telangana
33	Chillakallu	132kV Bonakal Line-1	Telangana
34	Kamavarapukota	132kV Aswraopet Line-2	Telangana
35	Kamavarapukota	132kV Aswraopet Line-1	Telangana
36	AP Carbides	132kV Alampur X Road Line II	Telangana
37	AP Carbides	132kV Alampur X Road Line I	Telangana
38	Kakinada	132 kV Yanam line	Puducherry



True Copy

As

Chief Engineer/Comm. & RAC
TSTRANSCO, Vidyut Soudha,
HYDERABAD - 500 082

Annexure-P2

18

SPEED POST / FAX

भारत सरकार
केन्द्रीय विद्युत प्राधिकरण
दक्षिण क्षेत्रीय विद्युत समिति
29, रेस कोर्स क्रॉस रोड
बेंगलूर :- 560 009



Government of India
Central Electricity Authority
Southern Regional Power Committee
29, Race Course Cross Road
BENGALURU - 560 009



फैक्स नं. : 0801-2000
TSD: 9001-2000

Phone : 080-2228 2516 ; FAX : 080-2225 9343 ; e-mail: secommmlsrpc-ka@nic.in ; web site: www.srpc.kar.nic.in

सं. दक्षेविस/अम.1/4(विचलन)/2016/

No. SRPC/SE-1/4(Dev)/2016/

दिनांक /Date : 23rd Nov. 2016

सेवा में / To

The Secretary,
CERC,
New Delhi.

Subject: Corrigendum- Certification of Interstate Transmission lines owned by STU, which carry inter-State power, for consideration of inclusion in POC charges 2016- Reg.

Ref : (i) SRPC letter No. SRPC/SE-1/4(Dev)/2016/ dated: 31st October, 2016
(ii) APTRANSCO Lr No CE/SLDC/SE/F.POC/D.NO 519 dt. 23.11.2016

Madam,


Kind reference is invited to SRPC letter cited above with respect to Certification of Interstate Transmission lines owned by Andhra Pradesh STU connecting Andhra Pradesh with other states, viz, Telangana, Tamil Nadu, Karnataka and Union Territory of Puducherry, for consideration of inclusion in POC charges, 2016.

It is stated that the following lines, which are interstate lines, were inadvertently not included in the referred list.

S.No.	Substation	Name of the Line	Connected to
1	Kalpaka	400 kV.Khammam Line I	Telangana
2	Kalpaka	400 kV Khammam Line II	Telatigana
3	Uravakonda	400kV Veltur Line I*	Telangana
4	Uravakonda	400kV Veltur Line II*	Telangana

* Taken into service on 18.11.2016

It is requested that the above four lines are also be taken as certified interstate lines owned by APTRANSCO connecting another state.

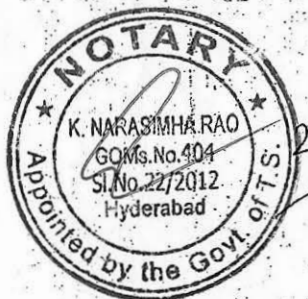

1
11/11

Chief Engineer/Comm. & RAC
APTRANSCO, Vidyut Sadhana,
HYDERABAD - 500 082

Director (Grid & Trans. Mgmt.)
APTRANSCO,
1193
23 NOV 2016

ED/HFD&Pld.	CE/LI, EA&Opn.
CE/SLDC&Comm.	CE/Gen&tr.
CE/Telecom	CE/400KV
CE/IPC&PS	CE/Civil
CE/Trans.	CE/Zonal/TL&SS
PS	

Director (Grid & Trans. Mgmt.)

True copy

19

Further, it is stated that the following changes/modifications with respect to the lines at S No. 21 and S No. 36 certified vide SRPC letter dated 31.10.2016 are made, as the lines are LILQed at Alipura and Gadwal respectively, which may kindly be considered for POC calculations.

S.No.	Substation	Name of the Line	Connected to
1	Ragulapadu (at S No. 21)	220 kV Alipura Line	Karnataka
2	AP Carbides (at S No. 36)	132 kV Gadwal Line	Telangana

The inconvenience caused is regretted.


Yours faithfully,

आर.एम. रंगराजन 22/11/16
(आर एम रंगराजन/R. M Rangarajan)

Encl : APTRANSCO ltr dt 23.11.2016

अधीक्षण अभियन्ता(वा)/Superintending Engineer (C)

Copy to : Chief Engineer, SLDC, APTRANSCO, Hyderabad-500 082.

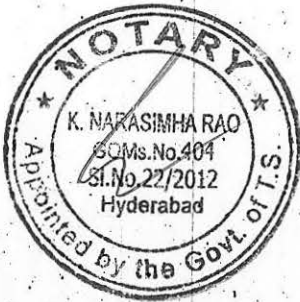


Chief Engineer/Comm. & RAC
TSTRANSCO, Vidyut Soudha,
HYDERABAD - 500 082.

True Copy

VAKALATNAMA

20

CENTRAL ELECTRICITY REGULATORY COMMISSION NEW DELHI

Petition No. /TT/2018

Transmission Corporation of Telangana Limited

...Petitioner

Vs

Transmission Corporation of Andhra Pradesh Limited & Ors.

...Respondent/s

I/We M. Srinivas, S/o Sri M. Thirupathy, aged 53 years, Occupation: CE/Comm. & RAC of Transmission Corporation of Telangana Limited, on behalf of the Petitioner in the above Petition/Application, do hereby appoint and retain **Mr. Sri Harsha Peechara**, Advocate to appear, plead and act for me/us in the above Petition/Application and to conduct and prosecute all proceedings that may be taken in respect thereof and applications for return of documents, enter into compromise and to draw any moneys payable to me/us in the said proceeding.

Place: Hyderabad

Date: 27/2/2018



Signature of the Party

Chief Engineer/Comm. & RAC
TSTRANSCO, Vidyut Soudha,
HYDERABAD - 500 082.

Identified
by Sri Harsha
[Signature]

"Accepted"

[Signature] 27/2/2018

(Sriharsha Peechara, Advocate)

(Sriharsha Peechara, Advocate)

Address for service on the counsel for Respondent

Full address: D-20, Nizamuddin East, New Delhi - 110013

Mobile: 9717466788

E-mail ID: shpeechara@gmail.com

